NATA LIGHTING CO.,LTD
www.nata.cn
Email:info@nata.cn
Tel:+86 0750-377 0000(10 lines) Fax:+86 0750-377 1111
Address:380JinOu Road,Gaoxin Zone,Jiang Men City,Guangdong,China

Nata

Client: NT
LumCAT: 3-3014-LM
Luminaire: BJB 47.360.2100
Report No: 20251118-B014
Ballast type: DC

Test No: 20251118-C014	Voltage(V): 52.480
LampCAT: Bridgelux V22 LES22	Current(A): 1.193
Lamp flux(lm): 9340.0	Power (W): 62.660
Number of Lamps: 1	PF: 0.000
Length(mm): 85	Width(mm): 85
Phm Type: C	Height(mm): 51

Photometric Results

Lumens(lm): 8719.26, Efficiency(%): 93.35% , Luminous Efficacy(lm/W): 139.15
Central intensity(cd): 18357.000, Maximum intensity(cd): 18379.600
Angle of maximum intensity: C=0.0 γ=3.0
Beam Angle(50%Imax): [C0/180]Total=39.0
[C90/270]Total=39.0
Field angle(10%Imax): [C0/180]Total=66.6
[C90/270]Total=66.6
Maximum s/h(1/2): C0_180=0.65 C90_270=0.65
Maximum s/h(1/4): C0_180=0.61 C90_270=0.61
Up flux rate of lamp(%): 0.00%
Down flux rate of lamp(%): 93.35%
Up flux rate of LUM(%): - -
Down flux rate of LUM(%): 100.00%
CIE Type : Direct lighting
Output flux ratio in π solid angle : 99.331%

Equipment: GMS1980	Date: 2025/11/18	Operator: YZQ
Temperature(°C): 25.0	Humidity(%): 60.0%	Distance(m): 9.28

Light Distribution Curve [Unit:cd]

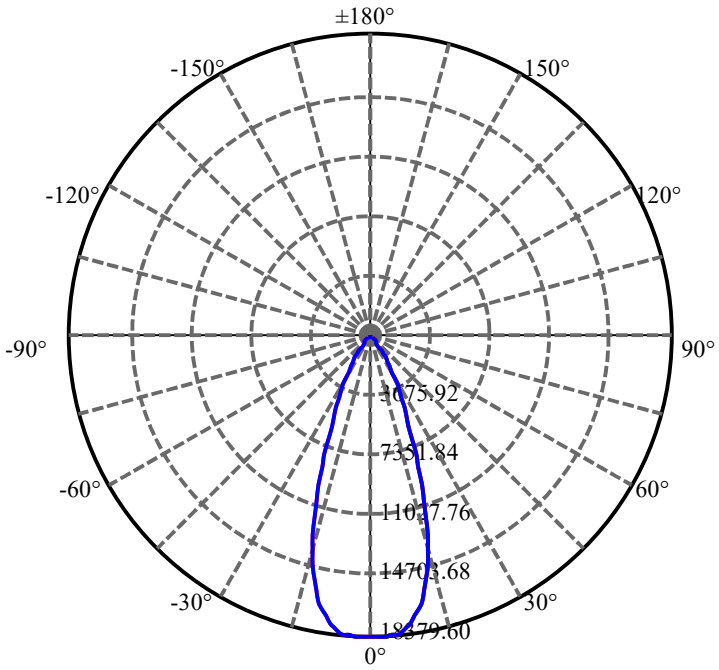

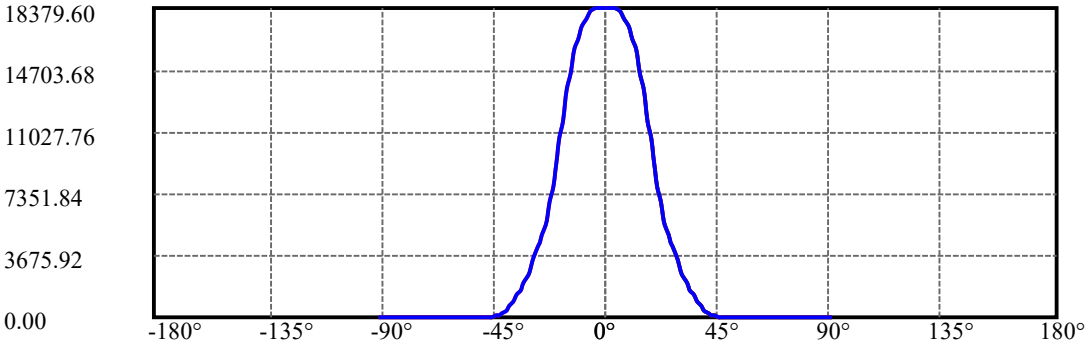

C0(Max):

C0/C180:

C90/C270:

Field angle(10%Imax):C0/180Left:36.3 Right:30.3
:C90/270Left:36.3 Right:30.3

Beam Angle(50%Imax):C0/180Left:22.5 Right:16.5
:C90/270Left:22.5 Right:16.5

Lux distance Curve

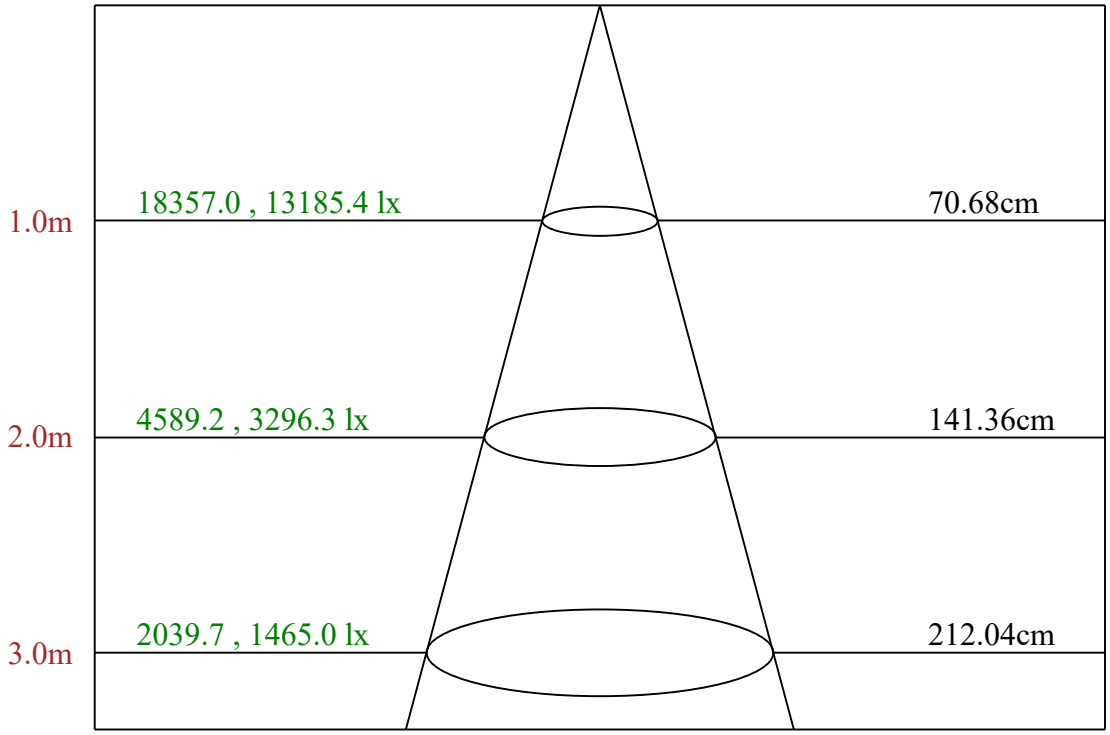

Max , Ave

Beam angle of C0 plane 38.93

ISO candela diagram on circular web

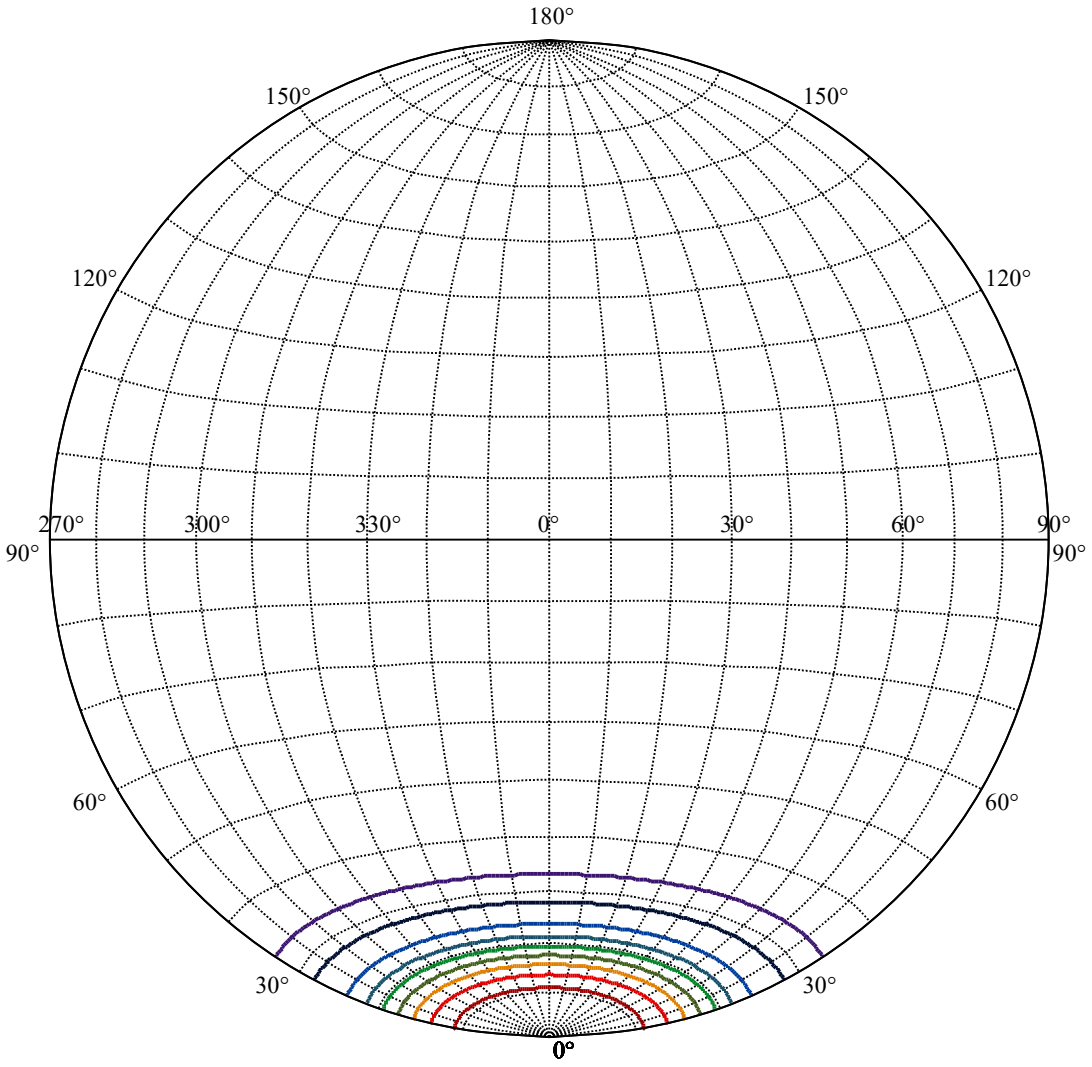

House [Unit:cd] Road

Imax:18379.60

(10%Imax) 1837.96
(20%Imax) 3675.92
(30%Imax) 5513.88
(40%Imax) 7351.84
(50%Imax) 9189.8
(60%Imax) 11027.8
(70%Imax) 12865.7
(80%Imax) 14703.7
(90%Imax) 16541.6

Equipment: GMS1980 Date: 2025/11/18 Operator: YZQ
Temperature(°C): 25.0 Humidity(%): 60.0% Distance(m): 9.28

NT Nata 3-3014-LM

ISO illuminance diagram

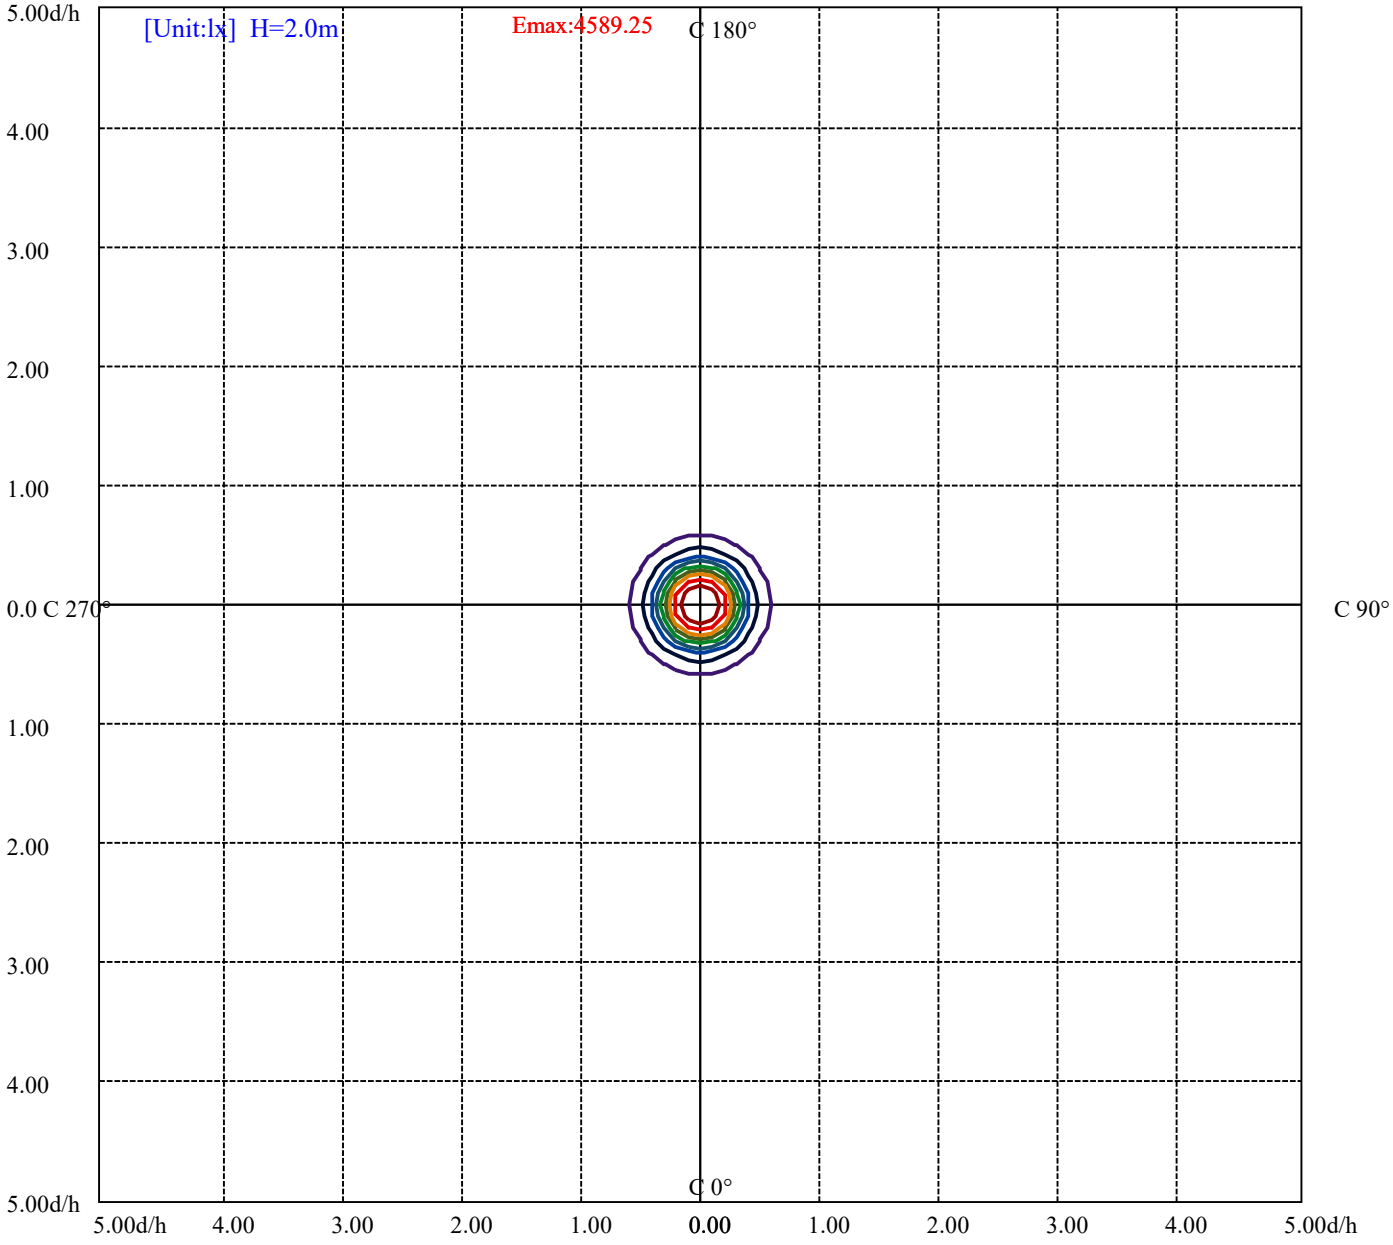

(10%Emax) 458.925
(20%Emax) 917.85
(30%Emax) 1376.775
(40%Emax) 1835.7
(50%Emax) 2294.625
(60%Emax) 2753.55
(70%Emax) 3212.475
(80%Emax) 3671.4
(90%Emax) 4130.325

Equipment: GMS1980
Temperature(°C): 25.0

Date: 2025/11/18
Humidity(%): 60.0%

Operator: YZQ
Distance(m): 9.28

Space ISO Lux diagram

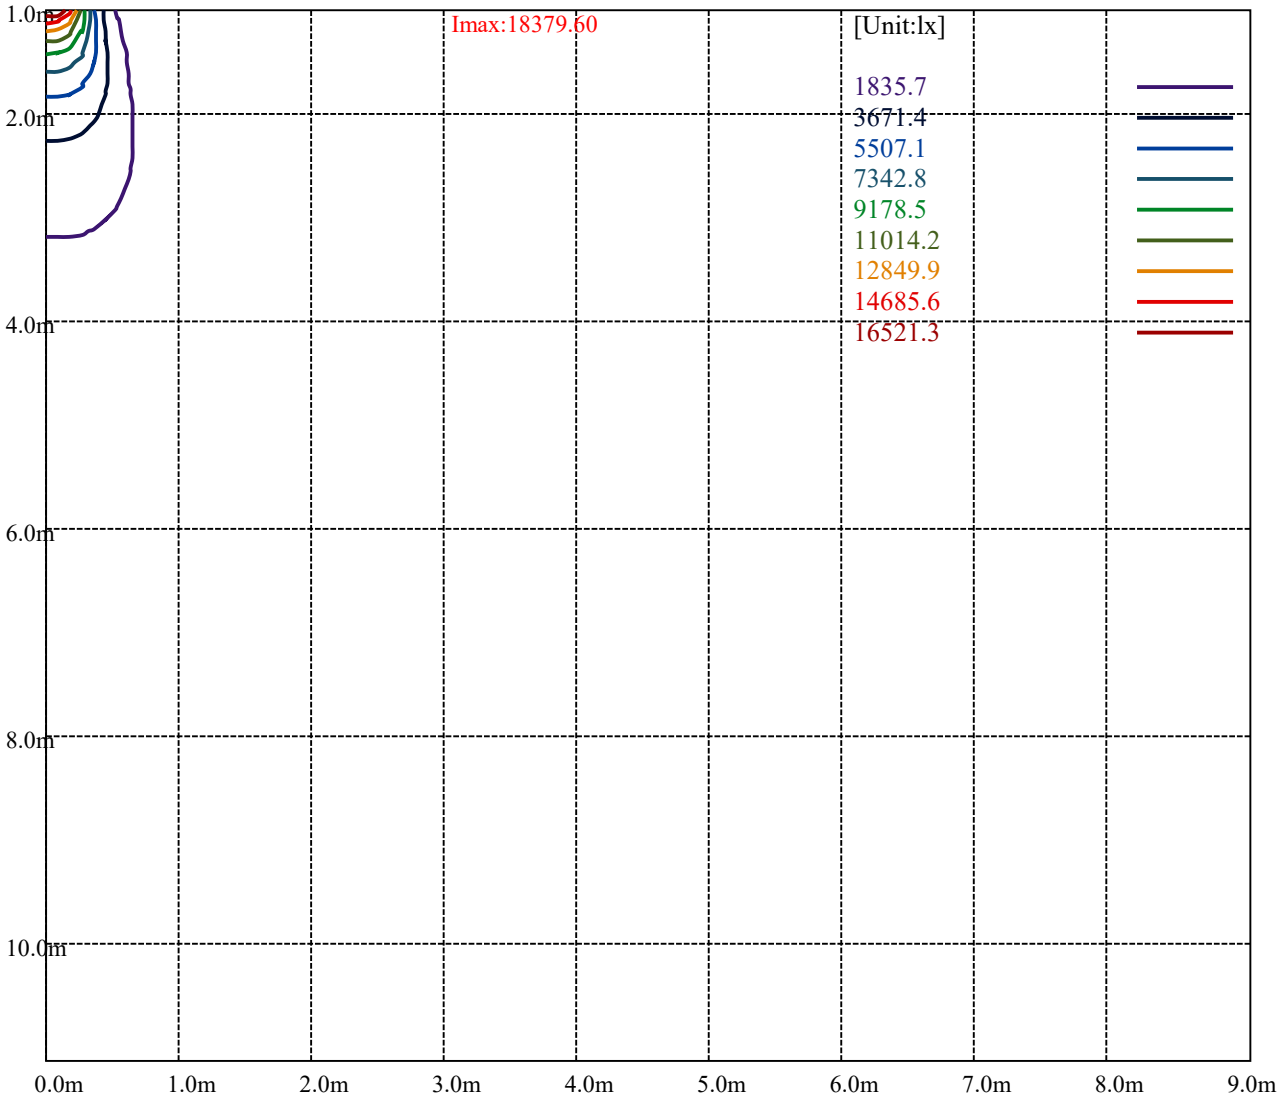

Equipment: GMS1980
Temperature(°C): 25.0

Date: 2025/11/18
Humidity(%): 60.0%

Operator: YZQ
Distance(m): 9.28

NT Nata 3-3014-LM

Luminance Limitting Curve(no luminous side)

Luminance Table

γ	45	50	55	60	65	70	75	80	85
C0	6595	3938	3135	2874	2820	2880	3025	3264	3577
C45	5708	3358	2632	2373	2287	2290	2351	2473	2627
C90	6595	3938	3135	2874	2820	2880	3025	3264	3577

L(Hor)(65)	L(Ver)(65)	L45(65)	L(Hor)(75)	L(Ver)(75)	L45(75)	L(Hor)(85)	L(Ver)(85)	L45(85)
6448	6448	6448	9798	9798	9798	28104	28104	28104

Glare Table

Glare	Quality	Service Values Illuminance(lx)							
1.15	A	2000	1000	500	<=300				
1.5	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.2	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300
		a	b	c	d	e	f	g	h

Luminance Limitting Curve

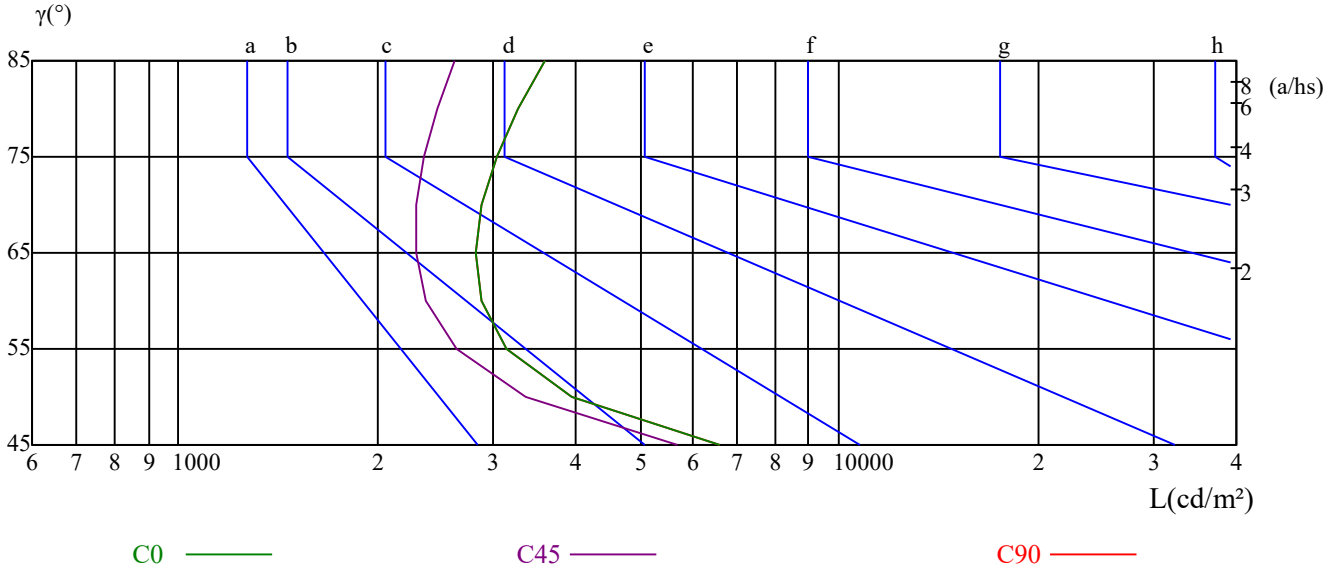

Equipment: GMS1980
Temperature(°C): 25.0

Date: 2025/11/18
Humidity(%): 60.0%

Operator: YZQ
Distance(m): 9.28

Illumination assessment according UGR											
Rf of Ceiling		70	70	50	50	30	70	70	50	50	30
Rf of Wall		50	30	50	30	30	50	30	50	30	30
Rf of Floor		20	20	20	20	20	20	20	20	20	20
Room dimensions		Viewed crosswise					Viewed endwise				
X	Y										
2H	2H	19.25	20.15	19.62	20.46	20.78	17.31	18.21	17.67	18.52	18.84
	3H	19.06	19.86	19.44	20.19	20.54	17.13	17.93	17.52	18.27	18.62
	4H	18.97	19.71	19.37	20.06	20.43	17.06	17.80	17.46	18.16	18.53
	6H	18.91	19.59	19.33	19.96	20.36	17.03	17.71	17.45	18.09	18.49
	8H	18.86	19.50	19.28	19.89	20.30	17.00	17.65	17.43	18.03	18.44
	12H	18.82	19.43	19.25	19.83	20.25	16.99	17.60	17.42	18.00	18.42
4H	2H	18.93	19.66	19.33	20.02	20.39	16.99	17.73	17.39	18.08	18.45
	3H	18.70	19.32	19.13	19.72	20.14	16.79	17.41	17.22	17.81	18.23
	4H	18.65	19.19	19.09	19.61	20.06	16.78	17.31	17.22	17.74	18.19
	6H	18.57	19.04	19.05	19.50	19.95	16.74	17.22	17.22	17.67	18.12
	8H	18.56	19.00	19.05	19.46	19.93	16.77	17.20	17.26	17.66	18.14
	12H	18.57	18.97	19.06	19.43	19.95	16.82	17.22	17.32	17.68	18.20
8H	4H	18.46	18.90	18.95	19.36	19.84	16.61	17.04	17.09	17.50	17.98
	6H	18.40	18.75	18.91	19.23	19.75	16.61	16.96	17.12	17.44	17.96
	8H	18.46	18.75	19.00	19.28	19.78	16.72	17.02	17.26	17.54	18.04
	12H	18.51	18.73	19.05	19.25	19.77	16.84	17.06	17.39	17.58	18.11
12H	4H	18.42	18.82	18.91	19.27	19.79	16.56	16.96	17.05	17.42	17.94
	6H	18.40	18.69	18.93	19.22	19.71	16.62	16.91	17.15	17.44	17.93
	8H	18.43	18.65	18.98	19.17	19.70	16.72	16.94	17.26	17.46	17.98

Variation with the observer position at spacings:		
S = 1.0H	6.0/-10.6	6.0/-10.6
S = 1.5H	8.7/-8.7	8.7/-8.7
S = 2.0H	10.5/-7.6	10.5/-7.6
Standard tables:	BK0	BK0
Uncorrected UGR	-1.4	-1.4

UGR calculation is based on CIE Publ. 117 ,S/H = 0.25

Budgetary Estimate Table

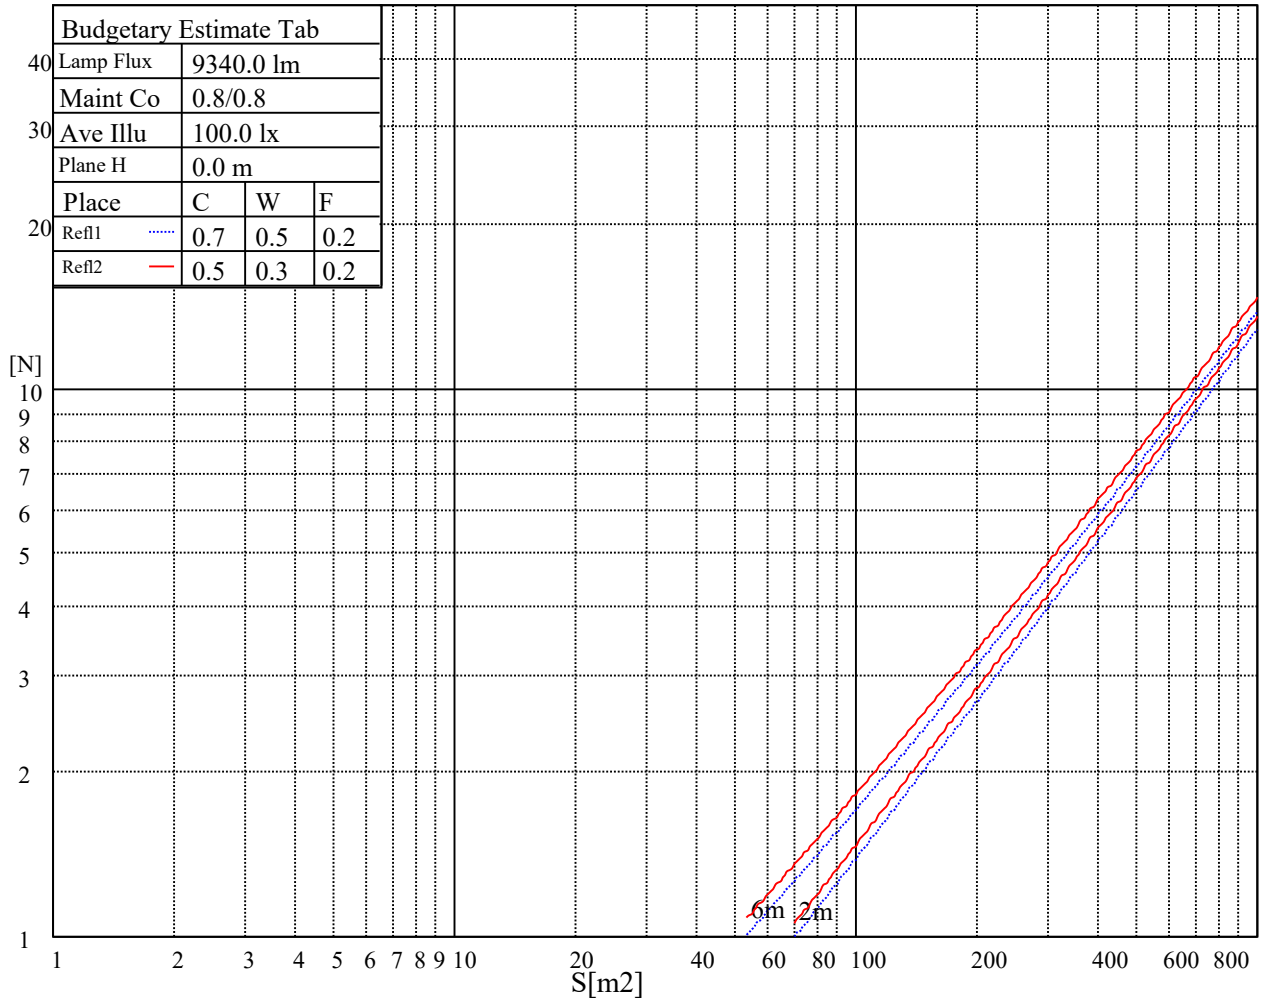

Equipment: GMS1980 Date: 2025/11/18 Operator: YZQ
Temperature(°C): 25.0 Humidity(%): 60.0% Distance(m): 9.28

Utilization factor table for indoor luminaire

RHOCC	80			70			50			30			10			0
RHOW	50	30	10	50	30	10	50	30	10	50	30	10	50	30	10	0
RCR	COEFFCIENTS OF UTILIZATION RHOFC=20 CU															
0	1.11	1.11	1.11	1.09	1.09	1.09	1.04	1.04	1.04	0.99	0.99	0.99	0.95	0.95	0.95	0.93
1	1.04	1.02	1.00	1.02	1.01	0.99	0.99	0.97	0.96	0.95	0.94	0.93	0.92	0.91	0.90	0.89
2	0.98	0.95	0.93	0.97	0.94	0.91	0.94	0.92	0.90	0.91	0.89	0.88	0.89	0.87	0.86	0.84
3	0.93	0.89	0.86	0.92	0.88	0.85	0.90	0.87	0.84	0.87	0.85	0.83	0.85	0.83	0.82	0.80
4	0.89	0.84	0.81	0.88	0.84	0.80	0.86	0.82	0.80	0.84	0.81	0.79	0.82	0.80	0.78	0.76
5	0.84	0.80	0.76	0.83	0.79	0.76	0.82	0.78	0.75	0.80	0.77	0.75	0.79	0.76	0.74	0.73
6	0.80	0.76	0.72	0.80	0.75	0.72	0.78	0.75	0.72	0.77	0.74	0.71	0.76	0.73	0.71	0.70
7	0.77	0.72	0.69	0.76	0.72	0.69	0.75	0.71	0.68	0.74	0.71	0.68	0.73	0.70	0.68	0.67
8	0.74	0.69	0.66	0.73	0.69	0.66	0.72	0.68	0.65	0.71	0.68	0.65	0.70	0.67	0.65	0.64
9	0.71	0.66	0.63	0.70	0.66	0.63	0.69	0.65	0.63	0.69	0.65	0.62	0.68	0.65	0.62	0.61
10	0.68	0.63	0.60	0.67	0.63	0.60	0.67	0.63	0.60	0.66	0.62	0.60	0.65	0.62	0.60	0.59

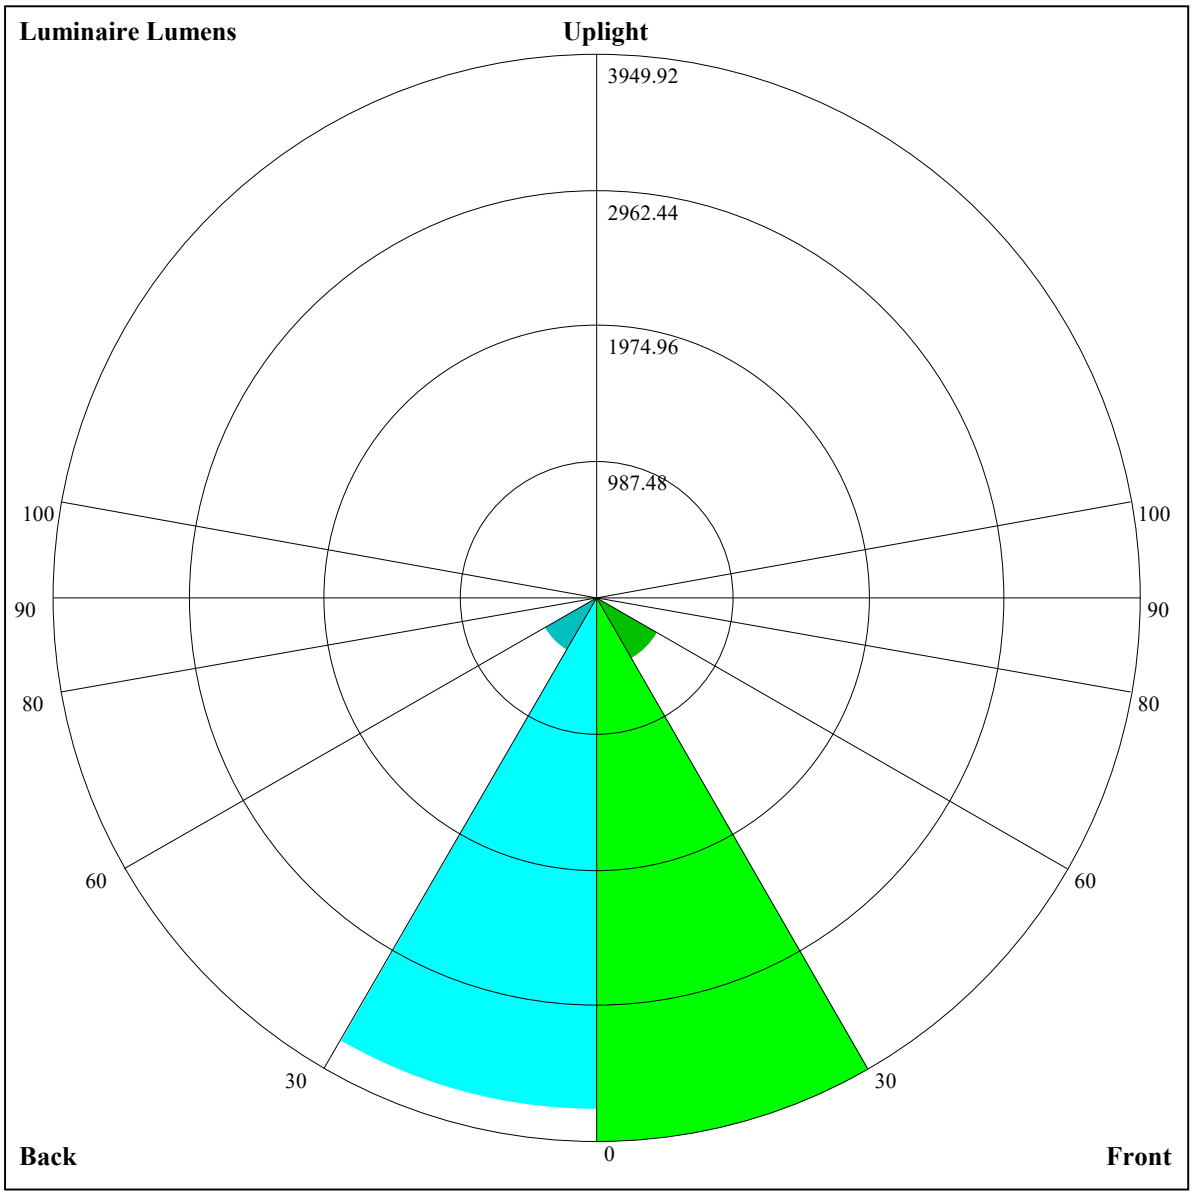

Luminaire Lumens:
FL=3949.92,FM=506.65,FH=19.56,FVH=9.68
BL=3725.59,BM=439.51,BH=19.48,BVH=9.65
UL=0,UH=0

BUG Rating:B4-U0-G0

Intensity data(cd)

C/γ(°)	0.0	1.0	2.0	3.0	4.0	5.0	6.0	7.0	8.0
0.0	18365.61	18331.16	18296.72	18270.88	18253.66	18210.60	18150.31	18046.97	17840.29
45.0	18408.67	18374.22	18348.39	18339.77	18322.55	18357.00	18365.61	18296.72	18201.99
90.0	18331.16	18339.77	18348.39	18374.22	18374.22	18374.22	18262.27	18141.70	17909.18
135.0	18322.55	18331.16	18348.39	18382.83	18391.45	18374.22	18313.94	18184.76	18012.52
180.0	18365.61	18391.45	18400.06	18391.45	18313.94	18210.60	18003.91	17685.27	17375.25
225.0	18408.67	18460.34	18512.01	18512.01	18468.95	18339.77	18107.25	17173.82	17173.82
270.0	18331.16	18357.00	18434.50	18477.56	18512.01	18520.62	18425.89	18270.88	18038.36
315.0	18322.55	18322.55	18313.94	18288.10	18236.43	18150.31	17995.30	17745.56	17078.23
360.0	18365.61	18331.16	18296.72	18270.88	18253.66	18210.60	18150.31	18046.97	17840.29

C/γ(°)	9.0	10.0	11.0	12.0	13.0	14.0	15.0	16.0	17.0
0.0	17168.65	17168.65	16865.51	16415.11	15893.24	15094.92	14402.53	13653.30	12845.51
45.0	18003.91	17797.23	17504.43	16961.88	16471.01	15876.79	15170.62	14214.70	13336.30
90.0	17076.50	17076.50	16713.95	16148.15	15500.54	14532.57	13674.83	12533.76	11541.67
135.0	17780.00	17469.98	16961.88	16479.62	15902.62	15093.11	14335.27	13542.98	12440.66
180.0	16832.70	16290.16	15704.55	15024.22	14085.53	13267.40	12414.83	11536.42	10399.66
225.0	17059.28	16384.97	15754.59	15026.02	14007.24	13102.14	11894.76	10875.12	9835.67
270.0	17754.17	17392.47	16824.09	16255.71	15618.43	14877.81	13870.23	12965.99	11975.62
315.0	17078.23	16618.35	15981.94	15353.27	14673.80	13944.38	12934.21	12073.89	10959.51
360.0	17168.65	17168.65	16865.51	16415.11	15893.24	15094.92	14402.53	13653.30	12845.51

C/γ(°)	18.0	19.0	20.0	21.0	22.0	23.0	24.0	25.0	26.0
0.0	11821.56	10962.96	10086.27	9002.04	8174.44	7387.32	6663.07	5857.86	5330.82
45.0	12414.83	11209.17	10244.64	9262.90	8065.85	7170.22	6343.48	5447.85	4879.47
90.0	10540.12	9281.07	8288.98	7353.74	6511.50	5576.25	4950.17	4467.91	4068.32
135.0	11536.42	10623.57	9495.41	8625.62	7781.66	7015.20	6154.02	5568.42	5077.54
180.0	9478.19	8625.62	7592.20	6825.74	6145.41	5430.63	4965.59	4474.71	4379.98
225.0	8806.55	7582.81	6700.10	5918.14	5253.31	4591.06	4182.86	3840.11	3426.74
270.0	10718.30	9693.49	8677.29	7471.63	6601.84	5818.16	5008.65	4517.77	4405.82
315.0	10060.44	9165.67	8090.05	7314.98	6601.92	5824.27	5308.42	4862.33	4459.30
360.0	11821.56	10962.96	10086.27	9002.04	8174.44	7387.32	6663.07	5857.86	5330.82

C/γ(°)	27.0	28.0	29.0	30.0	31.0	32.0	33.0	34.0	35.0
0.0	4887.31	4393.85	4010.62	3562.80	3209.72	2862.66	2526.80	1674.83	1674.83
45.0	4397.21	4397.21	3569.69	3247.61	2941.89	2566.41	2288.25	2018.70	1757.76
90.0	3623.09	3289.81	2973.75	2609.47	2327.87	1676.90	1676.90	1488.73	1253.80
135.0	4655.56	4354.15	4354.15	3451.71	3028.87	2701.62	2387.29	2008.37	1718.15
180.0	4379.98	3427.60	2984.95	2654.26	2340.78	2038.51	1676.81	1403.82	1150.63
225.0	3108.10	2808.41	2444.99	1967.89	1658.47	1600.17	1359.38	1128.75	856.19
270.0	4405.82	3349.23	3017.67	2719.71	2437.24	2103.96	1848.19	1594.14	1298.75
315.0	3965.84	3580.03	3215.75	2864.38	2441.54	1698.51	1698.51	1496.57	1239.24
360.0	4887.31	4393.85	4010.62	3562.80	3209.72	2862.66	2526.80	1674.83	1674.83

C/γ(°)	36.0	37.0	38.0	39.0	40.0	41.0	42.0	43.0	44.0
0.0	1535.49	1269.13	958.07	722.36	514.73	348.44	194.46	124.87	101.62
45.0	1439.12	1196.27	962.89	692.48	500.43	455.65	266.02	82.67	58.65
90.0	969.00	757.76	566.66	387.02	203.07	100.84	59.77	52.88	44.87
135.0	1371.09	1111.87	871.60	656.31	459.96	459.96	154.58	113.25	92.75
180.0	917.25	621.86	474.60	474.60	151.48	114.54	96.97	79.06	64.76
225.0	651.40	466.76	305.72	145.45	73.29	58.22	50.55	41.16	33.59
270.0	1084.32	820.79	621.86	436.71	436.71	118.84	69.15	60.63	52.88
315.0	998.80	720.21	522.05	347.75	186.53	122.29	103.26	88.53	69.24
360.0	1535.49	1269.13	958.07	722.36	514.73	348.44	194.46	124.87	101.62

Intensity data(cd)

C/γ(°)	45.0	46.0	47.0	48.0	49.0	50.0	51.0	52.0	53.0
0.0	84.22	70.62	51.84	46.33	41.85	38.15	34.28	31.95	29.97
45.0	49.95	43.06	34.53	31.95	29.71	28.25	27.21	26.18	25.06
90.0	37.20	32.55	30.23	28.76	27.56	26.27	25.40	24.54	23.77
135.0	78.97	64.07	56.41	48.92	44.18	40.39	36.51	33.76	31.00
180.0	57.01	50.12	45.13	40.99	37.63	34.10	31.78	29.80	27.82
225.0	31.61	29.54	28.25	26.87	26.01	25.15	24.37	23.34	22.65
270.0	40.30	32.12	30.40	28.94	27.47	26.52	25.66	24.72	23.94
315.0	52.02	46.59	42.11	37.55	34.62	32.12	29.71	27.99	26.09
360.0	84.22	70.62	51.84	46.33	41.85	38.15	34.28	31.95	29.97

C/γ(°)	54.0	55.0	56.0	57.0	58.0	59.0	60.0	61.0	62.0
0.0	28.25	26.35	25.15	24.20	23.42	22.56	22.05	21.44	21.01
45.0	24.37	23.68	22.82	22.30	21.87	21.44	21.10	20.84	20.50
90.0	22.99	22.48	21.96	21.53	21.19	20.93	20.50	20.32	20.07
135.0	29.19	27.30	26.01	24.80	23.85	23.08	22.39	21.62	21.19
180.0	26.09	24.97	24.03	23.08	22.39	21.70	21.27	20.84	20.50
225.0	22.13	21.70	21.27	21.01	20.75	20.50	20.24	19.98	19.72
270.0	23.08	22.48	22.05	21.62	21.27	21.01	20.75	20.41	20.24
315.0	24.97	24.03	23.25	22.48	21.87	21.44	21.10	20.58	20.32
360.0	28.25	26.35	25.15	24.20	23.42	22.56	22.05	21.44	21.01

C/γ(°)	63.0	64.0	65.0	66.0	67.0	68.0	69.0	70.0	71.0
0.0	20.67	20.24	20.07	19.81	19.63	19.38	19.20	19.03	18.95
45.0	20.32	20.07	19.89	19.63	19.46	19.29	19.20	19.03	18.95
90.0	19.89	19.63	19.46	19.29	19.12	19.03	18.86	18.77	18.69
135.0	20.84	20.50	20.15	19.89	19.63	19.38	19.20	19.03	18.95
180.0	20.07	19.89	19.63	19.29	19.20	19.03	18.95	18.77	18.69
225.0	19.55	19.38	19.20	19.12	18.95	18.86	18.77	18.60	18.52
270.0	19.98	19.81	19.55	19.38	19.29	19.12	19.03	18.86	18.69
315.0	20.07	19.72	19.55	19.29	19.12	19.03	18.86	18.69	18.60
360.0	20.67	20.24	20.07	19.81	19.63	19.38	19.20	19.03	18.95

C/γ(°)	72.0	73.0	74.0	75.0	76.0	77.0	78.0	79.0	80.0
0.0	18.77	18.69	18.52	18.43	18.43	18.34	18.26	18.17	18.08
45.0	18.77	18.69	18.60	18.52	18.43	18.34	18.34	18.26	18.17
90.0	18.60	18.43	18.34	18.26	18.26	18.17	18.08	18.00	18.08
135.0	18.77	18.60	18.52	18.43	18.34	18.26	18.17	18.08	18.00
180.0	18.60	18.43	18.34	18.26	18.17	18.08	18.08	18.00	18.00
225.0	18.52	18.34	18.26	18.17	18.08	18.08	18.08	18.00	18.00
270.0	18.69	18.52	18.43	18.34	18.26	18.17	18.17	18.08	18.08
315.0	18.52	18.34	18.26	18.17	18.17	18.08	18.00	17.91	17.83
360.0	18.77	18.69	18.52	18.43	18.43	18.34	18.26	18.17	18.08

C/γ(°)	81.0	82.0	83.0	84.0	85.0	86.0	87.0	88.0	89.0
0.0	18.08	18.08	17.91	17.91	17.74	17.57	17.57	17.48	17.57
45.0	18.08	18.08	18.08	18.00	18.00	17.83	17.57	17.48	17.48
90.0	18.08	18.17	18.08	18.08	18.00	17.57	17.48	17.40	17.31
135.0	18.00	17.91	17.83	17.83	17.83	17.74	17.57	17.48	17.40
180.0	17.91	17.83	17.83	17.65	17.48	17.48	17.40	17.65	17.40
225.0	18.00	17.91	17.74	17.48	17.48	17.40	17.40	17.31	17.31
270.0	18.00	18.08	18.00	17.65	17.57	17.48	17.48	17.40	17.40
315.0	17.83	17.74	17.57	17.57	17.48	17.48	17.48	17.40	17.31
360.0	18.08	18.08	17.91	17.91	17.74	17.57	17.57	17.48	17.57

Intensity data(cd)

C/γ(°)	90.0
0.0	17.57
45.0	17.40
90.0	17.40
135.0	17.40
180.0	17.40
225.0	17.40
270.0	17.40
315.0	17.40
360.0	17.57